


# Concentration of Magnesium Detected in NC Private Well Water ( $\mu\text{g/L}$ ), Average 2010

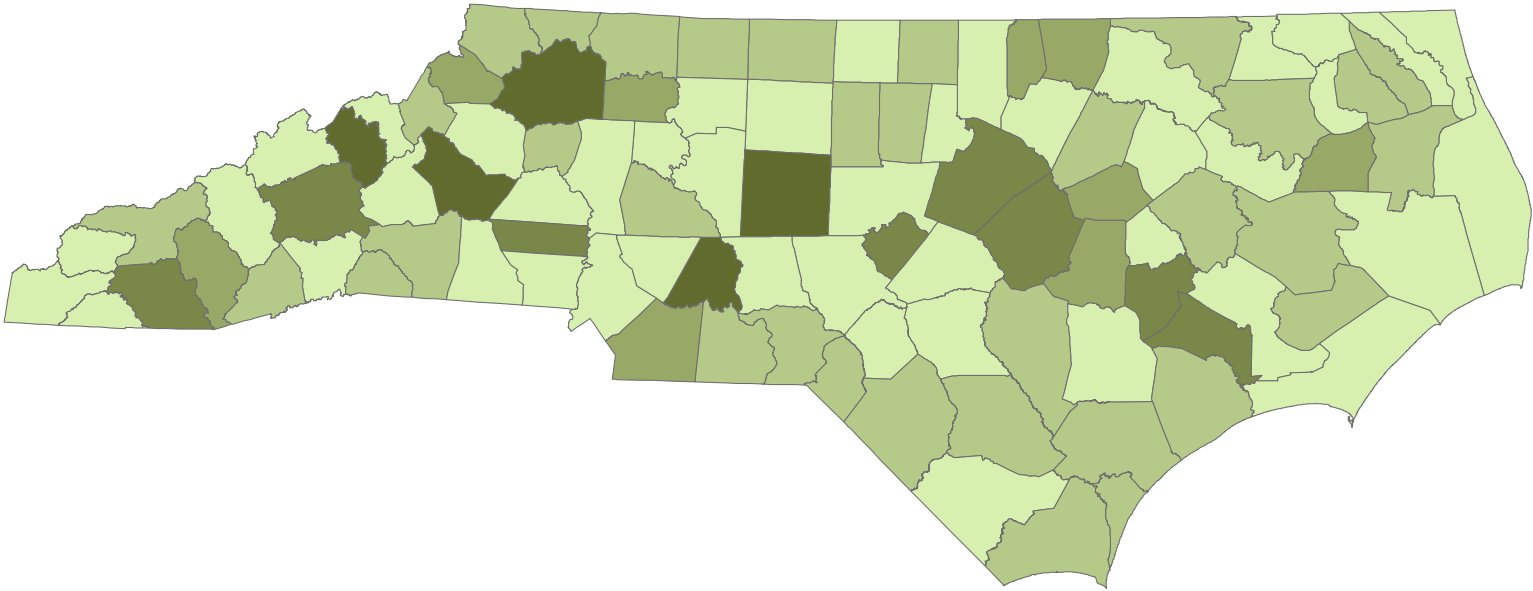

### Concentration of magnesium detected in private wells ( $\mu\text{g/L}$ )

- 50.00 - 2,500.00
- 2,500.01 - 5,500.00
- 5,500.01 - 10,000.00
- 10,000.01 - 20,000.00
- 20,000.01 - 137,878.48

### Magnesium: no drinking water standard

Magnesium can occur in drinking water from the erosion of natural mineral deposits. Magnesium and calcium are typically measures of water “hardness”.<sup>11</sup>

[Information about secondary contaminants in drinking water.](#)

